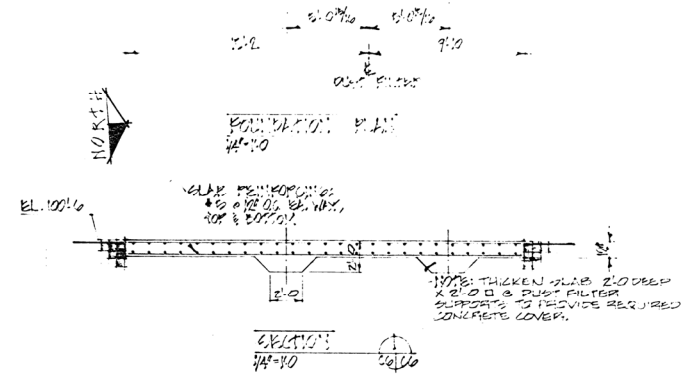
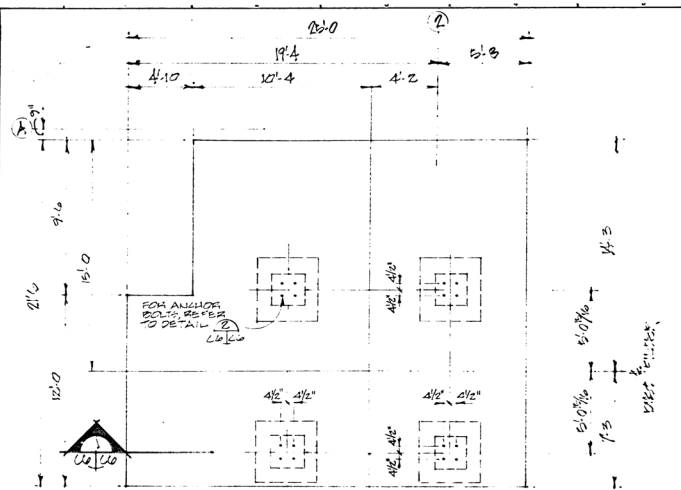


DETAIL 2
1/2" x 10" (6 THUS) 60,000

NOTES:

1. REFER TO DWG. 61 FOR GENERAL CONCRETE NOTES.
2. ALL CONCRETE TO HAVE MINIMUM 4,000 PSI COMPRESSIVE STRENGTH AT 28 DAYS.
3. ALL REINFORCING STEEL TO BE A601 GRADE 60 (60,000 PSI) DEFORMED REINFORCING STEEL.
4. REINFORCING CORE TO BE 3" @ SIDES & BOTTOM, 4" @ TOP.
5. ALL REINFORCING & PLACEMENT OF THE REINFORCING STEEL TO FOLLOW THE GUIDELINES & GOOD PRACTICES OF THE FOLLOWING CODE REQUIREMENTS FOR REINFORCED CONCRETE:
 - a. THE AMERICAN CONCRETE INSTITUTE & NATIONAL OF STANDARD PRACTICES IN THE CONCRETE REINFORCING CODE.

DATE		DATE			DATE 7-20-81	PLAN & DETAILS PU. S. FILTER FOUNDATION	PLAN	REVISION	
DATE		DATE			SCALE NOTED		DRAWN BY DE	3052	2
DATE		DATE	7-15-82		CHCKD BY DE		GENERAL REVISIONS		
DATE		DATE	7-21-81		APPROV BY AEP		ORIGINAL ISSUE		
DATE		DATE		PRINTED		3660 09		KIBOOR ENGINEERING COMPANY Kiboor, Alaska	SHEET C6